
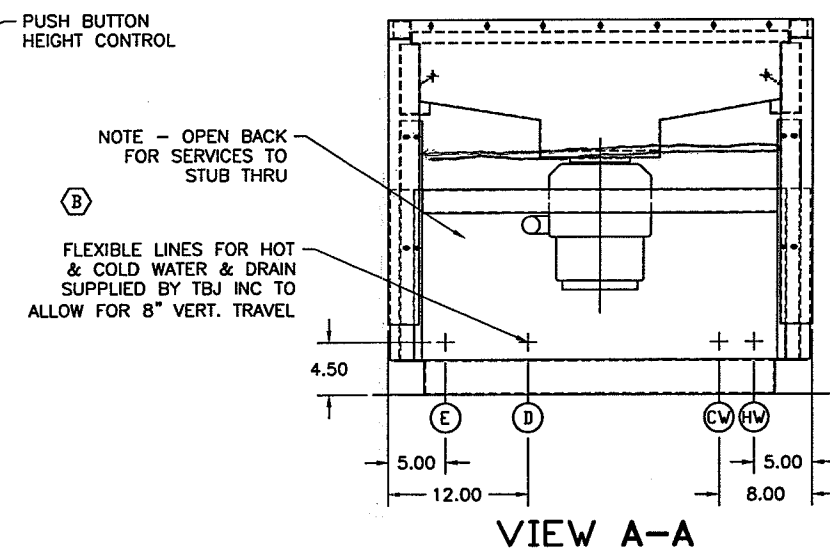
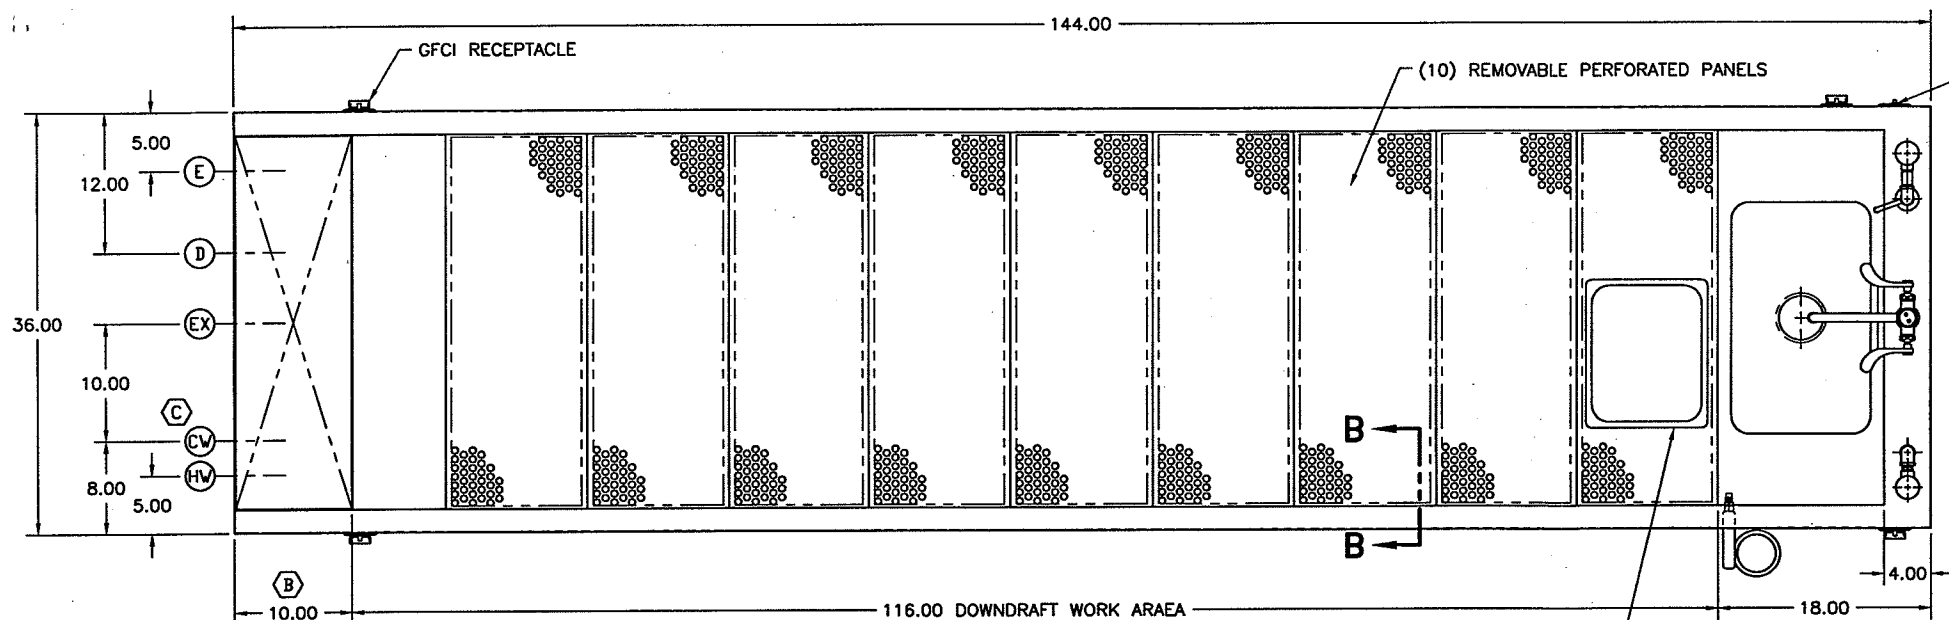
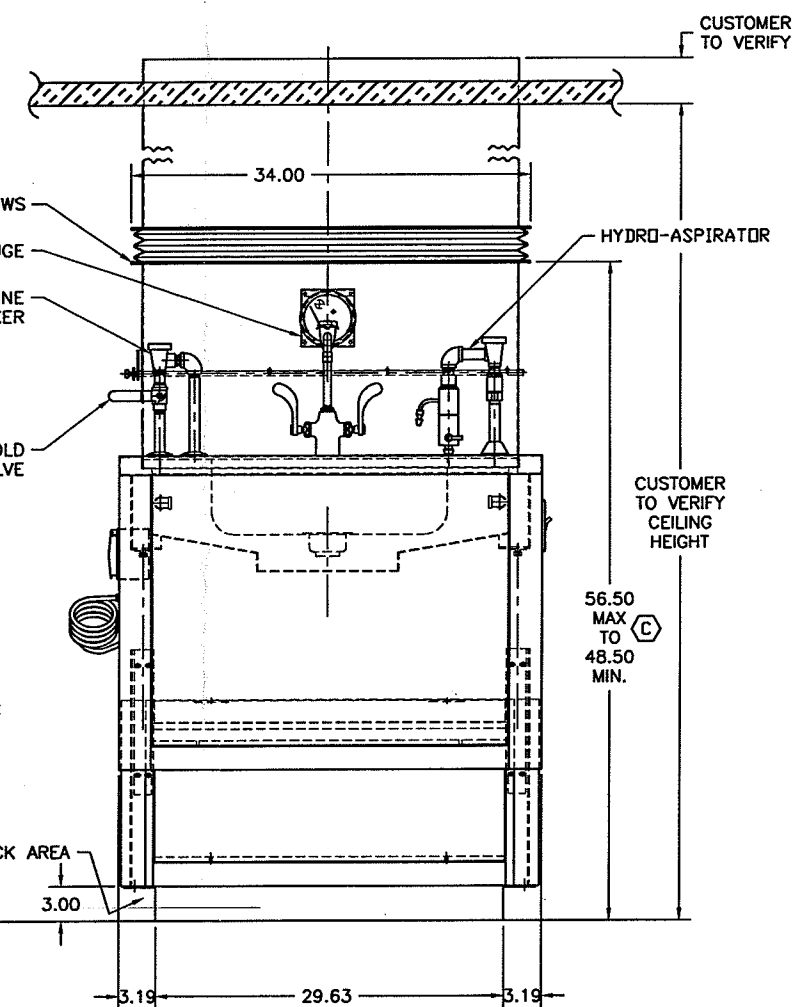


SECTION B-B

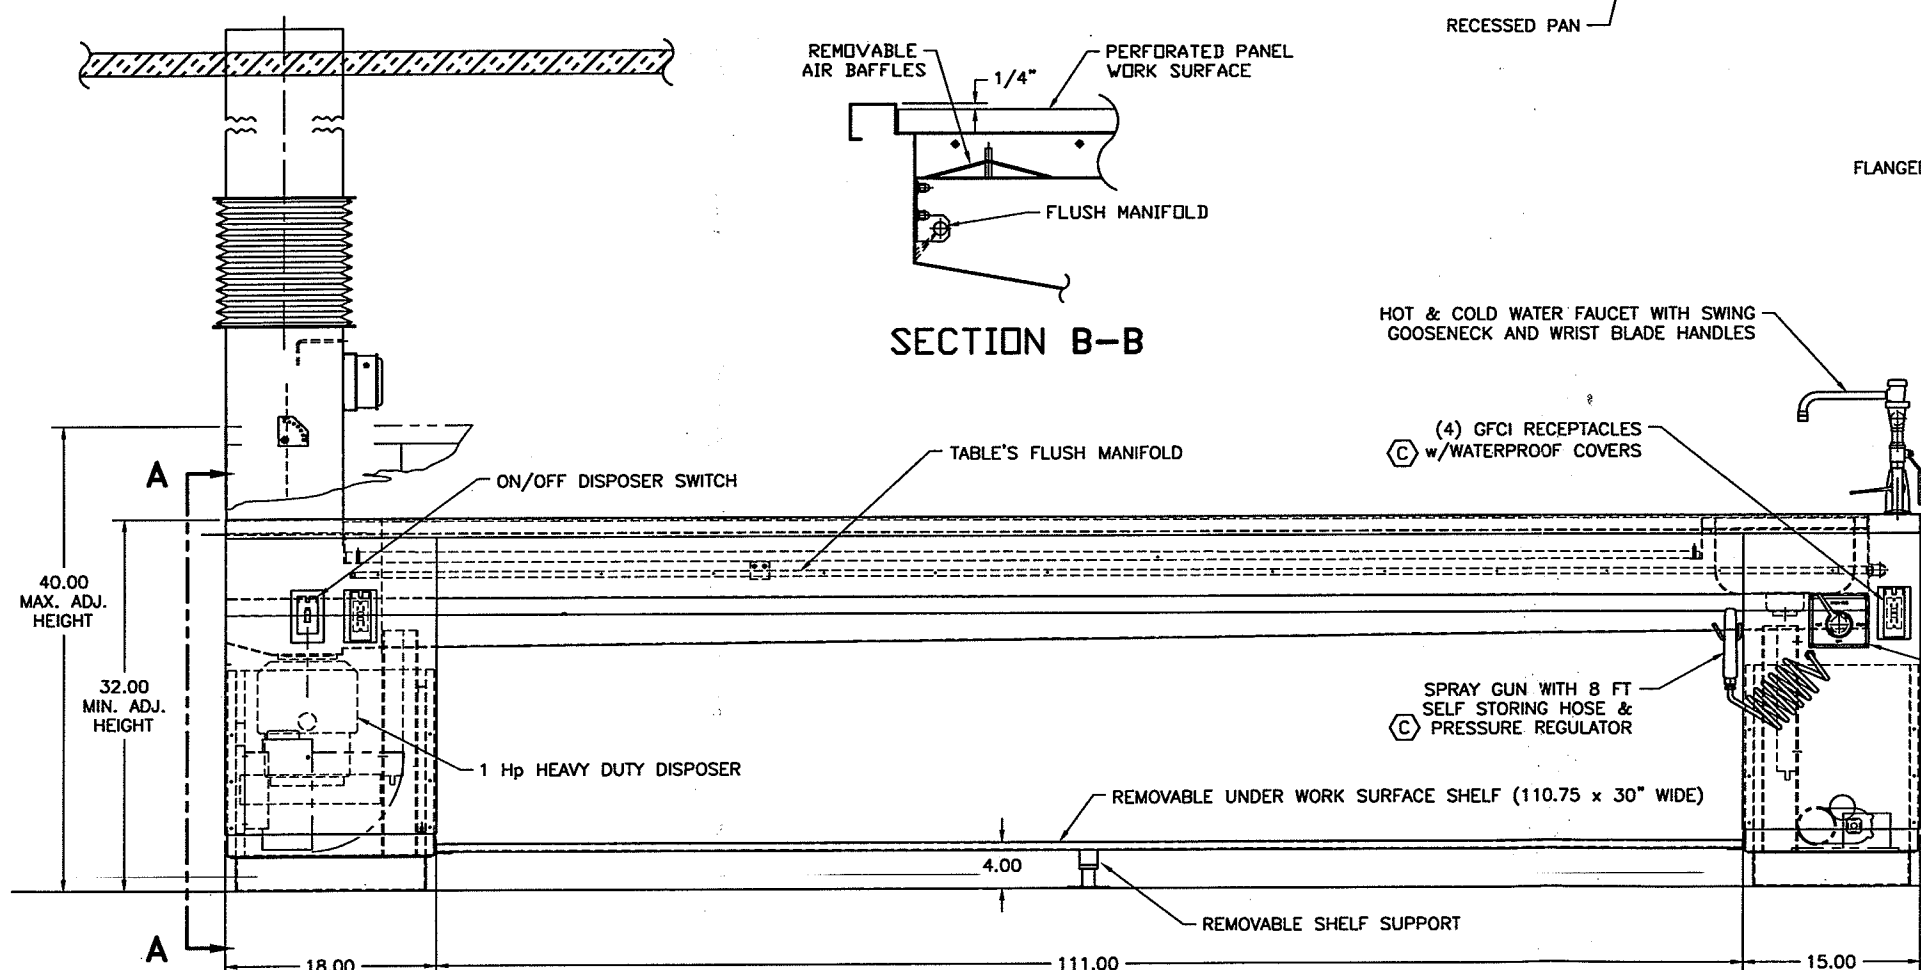

UTILITY REQUIREMENTS

- (E) ELECTRICAL - 115 V., 1 PH., 60 Hz., 30 AMP
- (CW) COLD WATER - 3/4" I.P.S.
- (HW) HOT WATER - 1/2" I.P.S.
- (D) DRAIN - 1 1/2" I.P.S.
- (EX) EXHAUST - 10" x 32" OUTSIDE DIMS

APPROVED

PRINT NAME:

DATE:

SIGNATURE:

INCLUDED OPTIONS

- AUTOMATIC ADJUSTABLE HEIGHT (8.0" TRAVEL)
- (1) THERMOPLASTIC CUTTING BOARD
- 1 Hp HEAVY DUTY DISPOSER
- (1) RECESSED PAN
- HYDRO ASPIRATOR ASSEMBLY
- DUCT EXTENSION TO CEILING
- (4) GFCI RECEPTACLES w/WATERPROOF COVERS
- (1) MAGNEHELIC GAUGE

TBJ INC.		1671 ORCHARD DRIVE CHAMBERSBURG, PA 17201	
C	WAS 52.50 MAX TO 44.50 MIN. & UPDATED NOTES	JEG	3-8-05
B	INCREASED DUCT'S WIDTH FROM 6" TO 10" & ADDED NOTES FOR FLEXIBLE UTILITY SUPPLY LINES	ALE	1-5-03
A	REVISED	CWF	12-15-03
LET	REVISION	BY	DATE
ROUGH-IN ASSEMBLY		R03137	